

# **Direct Grid Integration of Renewable Energy Systems Using a High-Frequency Link Cascaded Medium-Voltage Converter**

**P. Bhaskar Prasad, B. Murali Mohan and M. Lakshmi Prasanna**

*Assistant Professor Dept of EEE, AITS Rajampet  
Assistant Professor Dept of EEE, AITS Rajampet  
(M. Tech), E. P. S Student Dept of EEE, AITS Rajampet*

## **Abstract**

This paper presents a High-frequency link multilevel cascaded medium voltage converter. Medium-voltage converters eliminate the step-up transformer for direct grid integration of renewable power plants, but MMC converters require multiple DC supplies. The high frequency magnetic link is used to generate the multiple isolated DC sources for all H-bridge inverter cells of the MMC converters and it also minimizes the voltage imbalance, common mode issues. The proposed system performance is analyzed in the MATLAB/Simulink environment. It is expected that the proposed new technology will have great potential for future renewable power generation and smart grid application.


**Index Terms**— Direct grid integration, high-frequency link, medium-voltage converters, modular multilevel cascaded converters, renewable energy systems.

## **I. INTRODUCTION**

The energy and environment represents two major areas of current global crisis and it is more and more widely recognized that renewable energy sources, especially wind and solar energy, can offer effective solutions to these enormous challenges as the wind and solar power development is experiencing dramatic growth. Since 2007, medium-and large scale PV power have attracted great interest and PV power plants of more than 10 MW in capacity have now become a reality [1]. More than 200 PV power plants have been installed in the world, each of them generating an output more than 10 MW. In future some are to have a capacity in excess of 250 MW. These multi-megawatt PV power plants require large area of land. So they are usually

installed in remote areas far from cities. However the renewable energy sources have highly variable daily and seasonal patterns and consumer power demands are also extremely variable in nature. Therefore it is difficult to operate a standalone power system which is supplied from only one renewable source unless there are appropriate energy storage facilities. For this grid integration is the only possible solution if enough storage facilities are not available.

Currently there are 318 GW of wind power generation installed worldwide. Wind farms cover large areas of land. The land area covered by a 3.6 MW turbine can be almost  $0.37 \text{ km}^2$ , such that 54 turbines would cover about a land area of  $20 \text{ km}^2$ . Offshore wind farms can save land rental expense which is equivalent to 10-18% of total operating and maintenance cost of a wind farm, offshore based wind farms have attracted great attention in the last few years. To integrate scattered wind turbine generators to a medium-voltage a power frequency transformer is commonly used to step-up the voltage for long distances transmission. Fig. 1. shows the traditional wind turbine with step-up transformer.

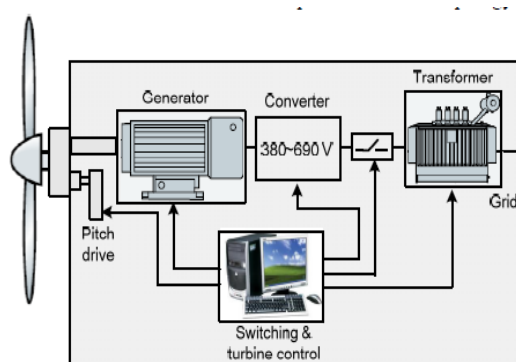

**Fig. 1. Fully rated converter based wind turbine generator system**

In an offshore wind turbine power generation system transformer is installed at a height of 80m inside the nacelle together with the other equipment such as the generator and converter. The tower diameter and weight depends on rotor and nacelle which is of heavy weight. Maintenance is also critical if liquid-filled step-up transformers used in the generation. Approximately the installation cost of offshore wind farm is 20% of the total capital cost. For these reasons considerable attention has recently been directed toward reducing the weight, size as well as maintenance cost by eliminating step-up transformer.

With the fast development of power electronics, it is becoming a reality to replace the combination of low-voltage inverter and step-up transformer by a medium voltage converter for direct grid connection to reduce the system volume and weight, as well as the cost. In comparison with the conventional two-and three-level converters, the multilevel converters present lower switching losses, lower voltage stress on the switching devices and higher equality output power, and thus suite better for medium-voltage applications. Although there are several multilevel converter topologies,

because of (e. g. some special features like number of components scales linearly with the number of levels, and individual modules are identical and completely modular in construction hence enabling high level number attainability) the modular multilevel cascaded (MMC) converter topology can be considered as a possible candidate for the medium-voltage applications [3]-[7]. However the MMC converter requires multiple isolated and balanced DC sources [9]-[11]. As a result its application is not straight forward, especially in wind power generation.

To eliminate the step-up transformer of wind turbine generators, in 2008 a multicoil modular permanent magnet generator was proposed [12]. This multiwinding generator has special winding arrangement and complicated control strategies to generate multiple DC supplies of the MMC converters. An improved control strategy was verified and is almost same generator converter system [13]-[14]. To eliminate the step-up transformer in 2010, another approach was proposed [15]. To generate multiple Dc supplies for the MMC converters a few six phase generators are placed in the nacelle. All the generators are driven by the same wind turbine and each stator winding generates an isolated source for an H-bridge inverter cell of the MMC converter. Even though these MMC converters generates medium-voltage ac outputs but these approaches requires special modular generators and multiple traditional generators to generate isolated multiple DC supplies for the MMC converters, and introduce electrical isolation problems between the generator and grid.

The quasi-Z source inverter has attracted significant attention in recent years due to some special features [16]-[17]. A medium-voltage PV inverter which is a combination of few quasi-Z source inverters into an MMC converter was proposed in 2012 [18], where the quasi-z source inverter generates dc supplies for the MMC converter, but it does not have electrical isolation between the PV array and medium-voltage grid. Multiple isolated high frequency link-based medium-voltage PV inverter topology was proposed [19]-[20] where the high frequency link generates dc supplies for the MMC converters. In these proposed systems voltage balancing is the challenging issue since each module is connected to a PV array through a dc/dc converter. A common dc link inverter was proposed in 2012 [21]-[22]. The proposed system may reduces the voltage imbalance problem in the grid side, but the generation of common dc-link voltage from different PV arrays makes the inverter operation complex and limits the range of maximum power point tracker (MPPT) operation.

Nowadays, it is common to use high-frequency magnetic links in designing grid-connected power electronic converters, which can provide electrical isolation without increasing system volume and weight [23]. For example, operated at 1. 2 kHz, the weight and size of a 3 MW transformer can be less than 8% of an equivalent 50 Hz unit. For fabrication of high-frequency transformer, the amorphous material has excellent magnetic characteristics such as high saturation flux density and relatively low specific core losses at medium to high frequencies [2]. The commercially available amorphous material is Metglas. The saturation flux density of the Metglas alloy 2605S3A is 1. 41 T and the specific core loss at 10 kHz sinusoidal excitation of 0. 5T is 20 W/kg.


In this paper, a high-frequency link cascaded medium-voltage converter is proposed for direct grid integration of renewable energy sources. Multiple isolated and balanced

DC supplies are generated by the common-magnetic link for all of the H-bridge inverter cells of the MMC converter from a single or multiple renewable energy sources. The high frequency link multilevel cascaded medium-voltage converter-based grid integration will have the following advantages: 1) No requirement for special or multiple generators for the wind turbine generator system; 2) a wide range of MPPT operation for PV systems; 3) An inherent dc-link voltage balance due to the common magnetic-link; 4) Direct grid integration without using step-up transformer; 5) An inherent minimization of the grid isolation problems through the high-frequency link; 6) An overall compact and light weight system. To verify the feasibility of the proposed system a simulink model is developed with modular five-level cascaded converter which gives three phase 1kV rms as output.

## II. PROPOSED MEDIUM-VOLTAGE CONVERTER-BASED DIRECT GRID INTEGRATION SYSTEM


### A. Basic block diagram of the proposed system

In this paper, as an approach to eliminate the step-up transformer to integrate renewable sources to grid, an amorphous alloy 2605SA1-based common magnetic link is considered. The array dc power is converted to a medium frequency ac through a medium-frequency inverter. The inverter is also ensures constant output voltage. The inverter is connected to a primary winding of a multiwinding high-frequency link. Each secondary winding works as an isolated source and is connected to an H-bridge cell through a bridge rectifier.

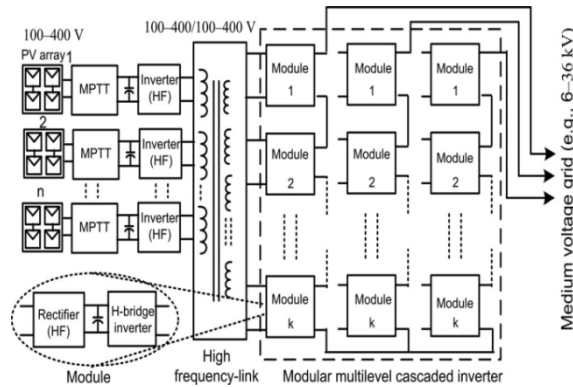

**Fig. 2. Proposed medium-voltage PV inverter system.**

The number of primary windings depends on the number of PV arrays and the number of secondary windings depends on the number of levels of the inverter. The detailed power circuit of a three-phase five level PV inverter system is shown in fig3. In large PV power plants, several PV arrays are operated in parallel. For this case, multi input and multi output magnetic link can be used, where each PV is connected to a primary winding through a booster and medium-frequency inverter as shown in fig2.

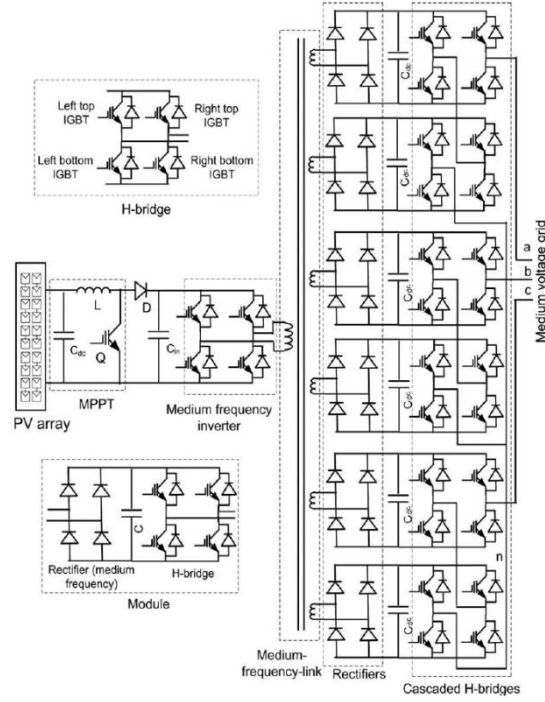

**Fig. 3. Detailed power conversion circuit**

The magnetic link provides electrical isolation between the PV array and the grid, thus inherently overcomes the common mode and voltage imbalance problems.

#### B. Design and Analysis of the Proposed System

If  $m_l$  is the number of levels of the converter, the number of cascaded modules on each phase can be calculated from

$$M_n = \frac{m_l - 1}{2} \quad (1)$$

If  $V_{ll}(\text{rms})$  is the grid line to line voltage, the minimum dc-link voltage of each  $H$ -bridge inverter cell can be calculated from

$$V_{dc(\min)} = \sqrt{2} \frac{V_{ll}(\text{rms})}{(m_l - 1)} \quad (2)$$

To determine the nominal dc-link voltage of each  $H$ -bridge inverter cell, a voltage reserve of 4% is assumed, i. e.,

$$V_{dc(\text{nom})} = 1.04 V_{dc(\min)} \quad (3)$$

If  $I_p(\text{rms})$  is the inverter phase current, the apparent output Power can be calculated from

$$S_c = \sqrt{3} V_{ll}(\text{rms}) I_p(\text{rms}) \quad (4)$$

The highest voltage rating of commercially available IGBT is 6.5 kV and, this is suitable for 2.5 kV and lower voltage inverter systems with traditional two-level converter topology. Although high voltage devices such as 3.3-, 4.5-, and 6.5 kV IGBTs are available in the market, They are still costly as shown in fig. 4.

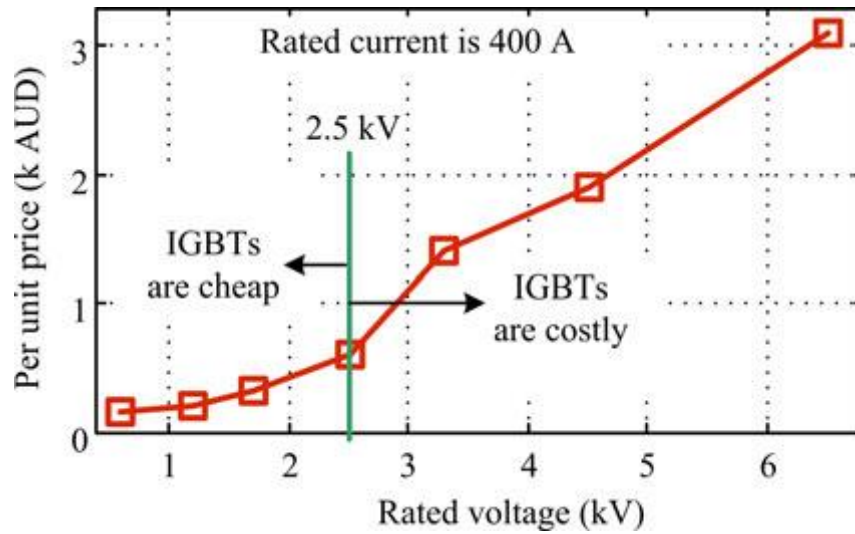


Fig. 4. Market price of power semiconductor devices (IGBTs).

The lower voltage devices, such as 0.6-, 0.9-, 1.2-, 1.7- and 2.5 kV IGBTs are not only matured in technology but also relatively low in price. On the other hand the cascaded connection of low voltage rated semiconductors can be a cost effective solution for medium-voltage inverter applications. The high-number of levels means that medium-voltage attainability is possible to connect the PV array to the medium-voltage ac network directly as well as possible to improve the output power quality. The total harmonic distortions (THD) of levels ranging from 7-level to 19-level with four modulation schemes (e. g., the phase shifted carriers with sinusoidal references (SPWM), the phase shifted carriers with third harmonic injected sinusoidal references (THPWM), the phase-shifted carrier with  $60^\circ$  modulated sinusoidal references (SDPWM), and the phase shifted carriers with trapezoidal type references (TRPWM)) is illustrated in fig. 5.

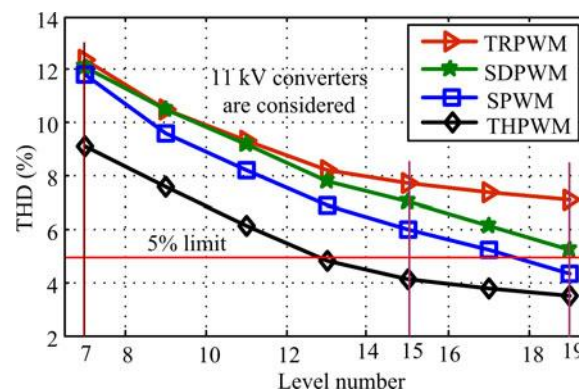


Fig. 5. Calculated THD at different number of levels ranging from 7-level to 19-level with four modulation schemes.

Component number and control complexity increases linearly as the number of levels increases. Therefore, the optimal selection of the number of inverter levels is important in order to achieve the best performance/cost ratio of the PV systems. Each H-bridge cell commutation voltage of a seven-level topology-based 11 kV inverter is 2696 V, which may be supported by the 6.5 kV IGBT. Thus, at least seven-level topology is required to design the 11-kV inverter. The output power quality of a 21-level inverter is good enough to feed into the 11-kV ac grid directly. The low-price 1.7-kV IGBT can be used to design the 21-level inverter. For a 33-kV system, at least 15-level topology is required and 55-level topology is sufficient for the power quality. Therefore, 7-level to 21-level MMC inverter topologies are considered for an 11-kV inverter system and 15-level to 55-level converter topologies are considered for the 33-kV system. The device voltage utilization factor (DVUF), ratio of commutation voltage of respective commutation cells ( $V_{dc \text{ nom}}$ ) and device commutation voltage for a device reliability of 100 failures in time (FIT) due to cosmic radiation ( $V_{com@100FIT}$ ) are summarised in table I. A higher DVUF is essential for the cost effective design, since the semiconductor cost is a significant figure for medium-voltage inverter applications. From Table I, it can be seen that only a few inverters have high DVUFs. In order to ensure a cost effective design, the inverters with levels of number 9, 11, 15, 19, and 21 for an 11-kV system are considered for the further analysis. The number of arithmetic and logical operation (ALOs) for switching section and cost of semiconductors are calculated and summarized in table II. The THD is calculated through MATLAB/Simulink environment.

**TABLE II Selection of IGBTs for MMC Converters**

Level number	$V_{com}$ (V)	Rated device voltage (kV)	$V_{com@100FIT}$ (V)	DVUF (%)
7	2696	6.5	3600	75
9	2022	4.5	2250	90
11	1618	3.3	1800	90
13	1348	3.3	1800	75
15	1156	2.5	1200	96
17	1011	2.5	1200	84
19	898	1.7	900	99
21	809	1.7	900	90


**TABLE II Comparison of MMC Converters**

Level number	9	11	15	19	21
IGBTs	48	60	84	108	120
THD (%)	9.60	8.20	6.00	4.30	4.25
Cost (AUD)	86400	82159	50400	36670	40744
ALOs	44	55	77	99	110

### III. Simulink Model and Result Analysis


To verify the feasibility of the proposed system a simulink model is developed with

modular five-level cascaded converter which gives three phase 1kV rms as output. Fig. 6. shows the PV sub system in the simulink model.

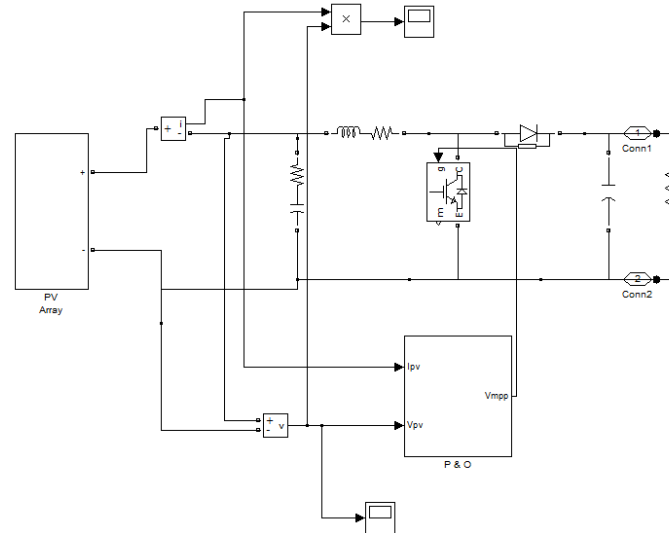


**Fig. 6. PV sub system.**

Gate pulses are applied to the switching devices of the converter and the obtained output voltage and line currents are as shown in fig. 7, fig. 8. Each level of the output voltage contains a number of PWM pulses.

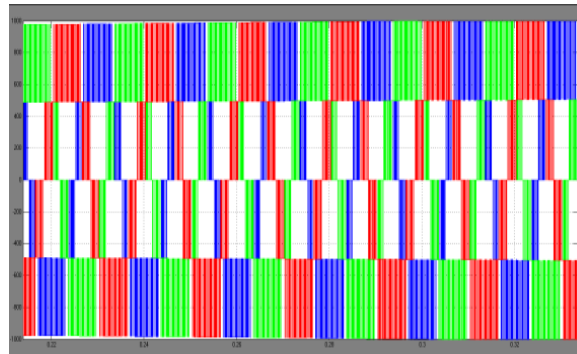


**Fig. 7. Simulated three phase line voltages of 1-kV multilevel cascaded converter**



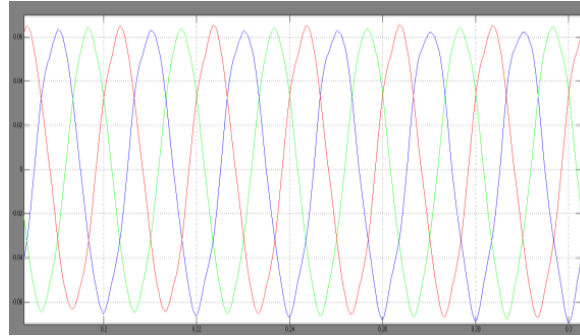

**Fig. 8. Simulated line currents of the 1-kV multilevel cascaded converter.**

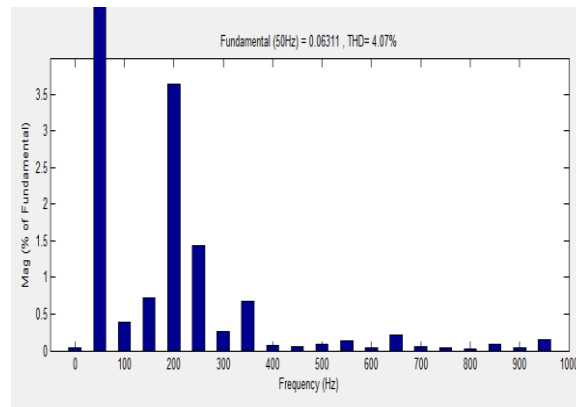


**Fig. 9. Frequency spectrum of line voltages**


The frequency spectrum of line voltages is shown in fig. 9. The output voltage waveform contains about 4.07% THD.

#### IV. EXTENSION WORK


Renewable energy sources have daily and seasonal variable patterns. Due to these reasons, uninterrupted power supply to any load is not possible by a stand-alone renewable resource. For this problem, grid integration of renewable sources is the only practical solution. In extension work both PV and Wind power generation systems are connected to the grid. There are always periods without wind. Thus, WECS must be linked energy storage or parallel generating system if supplies are to be maintained. Fig. 10. shows the sub system of wind power generation along with PV sub system. The following are the simulation results when two renewable sources (PV, Wind power generation systems) are connected to the grid through medium/high frequency link.

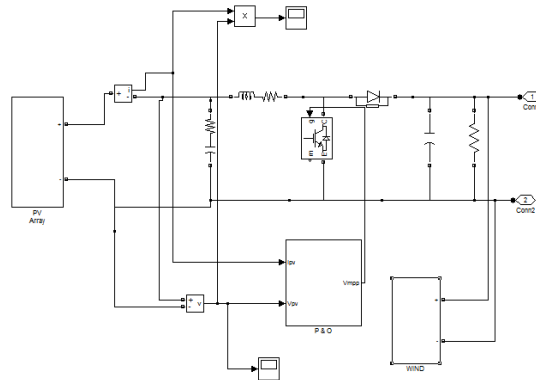

**Fig. 10.** Sub system of Wind power generation system along with PV system.

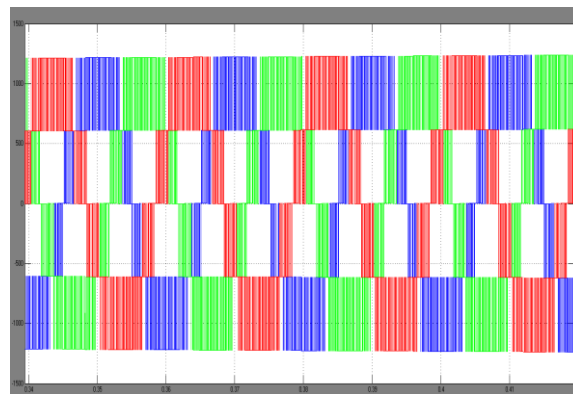


**Fig. 11.** simulated three phase line voltages of 1.2 kV multilevel converter.

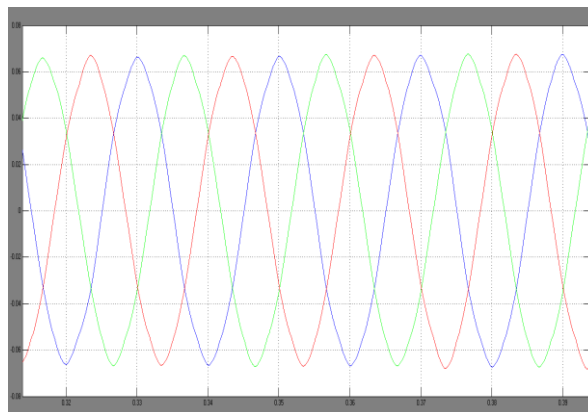

**Fig. 12.** Simulated three phase line currents of 1.2 kV multilevel converter.

The frequency spectrum of line voltages when two renewable sources (PV, Wind power generation systems) are connected to grid is shown in fig. 13. The Output voltage waveform contains about 2.24% THD.

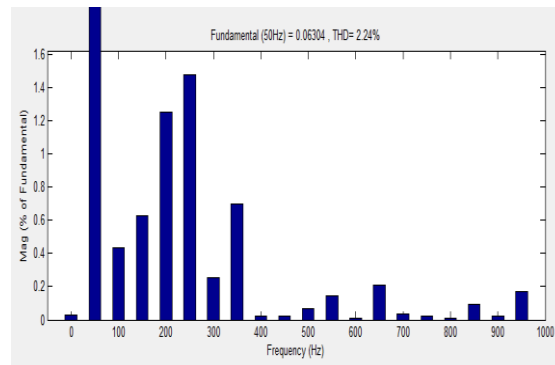

**Fig. 13. Frequency spectrum of line voltages.**

## V. CONCLUSION

In this paper, a new-medium voltage PV inverter system is proposed for medium – or large-scale PV power plants. A common magnetic link is employed to interconnect PV arrays to form a single source. Multiple isolated and balanced dc supplies for the multilevel inverter have been generated through the common magnetic link, which automatically minimizes the voltage imbalance problem. The grid isolation and safety problems have also been solved inherently due to electrical isolation provided by the High-frequency link. Although the additional windings and rectifiers may increase loss of the proposed system, the overall performance is still similar to the traditional system. The elimination of line filter and step-up transformer from traditional system will enable the large cost savings in terms of the installation, running and maintenance of the PV power plant.. In extension work both PV and Wind generation systems are connected to the grid to give uninterrupted power supply to the required areas. Here, the proposed medium-voltage system has been developed by MATLAB/Simulink model.

## REFERENCES

- [1] M. R. Islam, Y. G. Guo, and J. G. Zhu, "A transformer-less compact and light wind turbine generating system for offshore wind farms, " in *Proc. IEEE Int. Conf. Power Energy*, Kota Kinabalu, Malaysia, Dec. 2–5, 2012, pp. 605–610.
- [2] M. R. Islam, Y. G. Guo, and J. G. Zhu, "A medium-frequency transformer with multiple secondary windings for grid connection through H-bridge voltage source converters, " in *Proc. Int. Conf. Electr. Mach. Syst.*, Sapporo, Japan, Oct. 21–24, 2012, pp. 1–6.
- [3] H. Akagi, "Classification, terminology, and application of the modular multilevel cascaded converter (MMCC), " *IEEE Trans. Power Electron.*, vol. 26, no. 11, pp. 3119–3130, Nov. 2011.
- [4] B. Gultekin and M. Ermis, "Cascaded multilevel converter-based transmission STATCOM: System design methodology and development of a 12

- kV  $\pm 12$  MVar power stage, " *IEEE Trans. Power Electron.*, vol. 28, no. 11, pp. 4930–4936, Nov. 2013.
- [5] F. Z. Peng, J. S. Lai, J. McKeever, and J. VanCoevering, "A multilevel voltage source inverter with separate dc sources for static VAR generation, " *IEEE Trans. Ind. Appl.*, vol. 32, no. 5, pp. 1130–1138, Sep. /Oct. 1996.
  - [6] M. Hagiwara, K. Nishimura, and H. Akagi, "A medium-voltage motor drive with a modular multilevel PWM inverter, " *IEEE Trans. Power Electron.*, vol. 25, no. 6, pp. 1786–1799, Jul. 2010.
  - [7] M. Hagiwara and H. Akagi, "Control and experiment of pulse-width-modulated modular multilevel converters, " *IEEE Trans. Power Electron.*, vol. 24, no. 7, pp. 1737–1746, Jul. 2009.
  - [8] M. R. Islam, Y. G. Guo, and J. G. Zhu, "Performance and cost comparison of NPC, FC and SCHB multilevel converter topologies for high-voltage applications, " in *Proc. Int. Conf. Electr. Mach. Syst.*, Beijing, China, Aug. 20–23, 2011, pp. 1–6.
  - [9] F. Deng and Z. Chen, "A control method for voltage balancing in modular multilevel converters, " *IEEE Trans. Power Electron.*, vol. 29, no. 1, pp. 66–76, Jan. 2014.
  - [10] T. Zhao, G. Wang, S. Bhattachaya, and Q. Huang, "Voltage and power balance control for a cascaded H-bridge converter-based solid-state transformer, " *IEEE Trans. Power Electron.*, vol. 28, no. 4, pp. 1523–1532, Apr. 2013.
  - [11] X. She, A. Q. Huang, T. Zhao, and G. Wang, "Coupling effect reduction of a voltage-balancing controller in single-phase cascaded multilevel converters, " *IEEE Trans. Power Electron.*, vol. 27, no. 8, pp. 3530–3543, Aug. 2012.
  - [12] C. H. Ng, M. A. Parker, L. Ran, P. J. Tavner, J. R. Bumby, and E. Spooner, "A multilevel modular converter for a large, light weight wind turbine generator, " *IEEE Trans. Power Electron.*, vol. 23, no. 3, pp. 1062–1074, May 2008.
  - [13] X. Yuan, Y. Li, J. Chai, and M. Ma, "A modular direct-drive permanent magnet wind generator system eliminating the grid-side transformer, " in *Proc. 13th Eur. Conf. Power Electron. Appl.*, Barcelona, Sep. 2009, pp. 1–7.
  - [14] X. Yuan, J. Chai, and Y. Li, "A transformer-less high-power converter for large permanent magnet wind generator systems, " *IEEE Trans. Sustainable Energy*, vol. 3, no. 3, pp. 318–329, Jul. 2012.
  - [15] F. Deng and Z. Chen, "A new structure based on cascaded multilevel converter for variable speed wind turbine, " in *Proc. 36th Annu. Conf. IEEE Ind. Electron. Soc.*, AZ, USA, Nov. 2010, pp. 3167–3172.
  - [16] Y. Zhou, L. Liu, and H. Li, "A high-performance photovoltaic module-integrated converter (MIC) based on cascaded quasi-Z-source inverters (qZSI) using eGaN FETs, " *IEEE Trans. Power Electron.*, vol. 28, no. 6, pp. 2727–2738, Jun. 2013.
  - [17] F. Guo, L. Fu, C. H. Lin, C. Li, W. Choi, and J. Wang, "Development of an 85-kW bidirectional quasi-Z-source inverter with dc-link feed-forward compensation for electric vehicle applications, " *IEEE Trans. Power Elec-*

- tron., vol. 28, no. 12, pp. 5477–5488, Dec. 2013.
- [18] D. Sun, B. Ge, F. Z. Peng, A. R. Haitham, D. Bi, and Y. Liu, “A new grid-connected PV system based on cascaded *H*-bridge quasi-*Z* source inverter,” in *Proc. IEEE Int. Symp. Ind. Electron.*, Hangzhou, China, May 28–31, 2012, pp. 951–956.
  - [19] H. Choi, W. Zhao, M. Ciobotaru, and V. G. Agelidis, “Large-scale PV system based on the multiphase isolated dc/dc converter,” in *Proc. 3rd IEEE Int. Symp. Power Electron. Distrib. Generation Syst.*, Aalborg, Denmark, Jun. 25–28, 2012, pp. 801–807.
  - [20] W. Zhao, H. Choi, G. Konstantinou, M. Ciobotaru, and V. G. Agelidis, “Cascaded *H*-bridge multilevel converter for large-scale PV grid-integration with isolated dc-dc stage,” in *Proc. 3rd IEEE Int. Symp. Power Electron. Distrib. Generation Syst.*, Aalborg, Denmark, Jun. 25–28, 2012, pp. 849–856.
  - [21] S. Kouro, C. Fuentes, M. Perez, and J. Rodriguez, “Single dc-link cascaded *H*-bridge multilevel multistring photovoltaic energy conversion system with inherent balanced operation,” in *Proc. 38th Annu. Conf. IEEE Ind. Electron. Soc.*, Montreal, QC, Canada, Oct. 25–28, 2012, pp. 4998–5005.
  - [22] S. Rivera, B. Wu, S. Kouro, H. Wang, and D. Zhang, “Cascaded *H*-bridge multilevel converter topology and three-phase balance control for large scale photovoltaic systems,” in *Proc. 3rd IEEE Int. Symp. Power Electron. Distrib. Generation Syst.*, Aalborg, Denmark, Jun. 25–28, 2012, pp. 690–697.
  - [23] K. Basu and N. Mohan, “A high frequency link single stage PWM inverter with common-mode voltage suppression and source based commutation of leakage energy,” *IEEE Trans. Power Electron.*, DOI: 10.1109/TPEL.2013.2280600.

